


This drawing is the property of OBSTA. This document cannot be reproduced, copied or communicated with third parties without the authorization of OBSTA. Ce document est la propriété d'OBSTA. Il ne peut être reproduit ou communiqué à des tiers sans son autorisation.

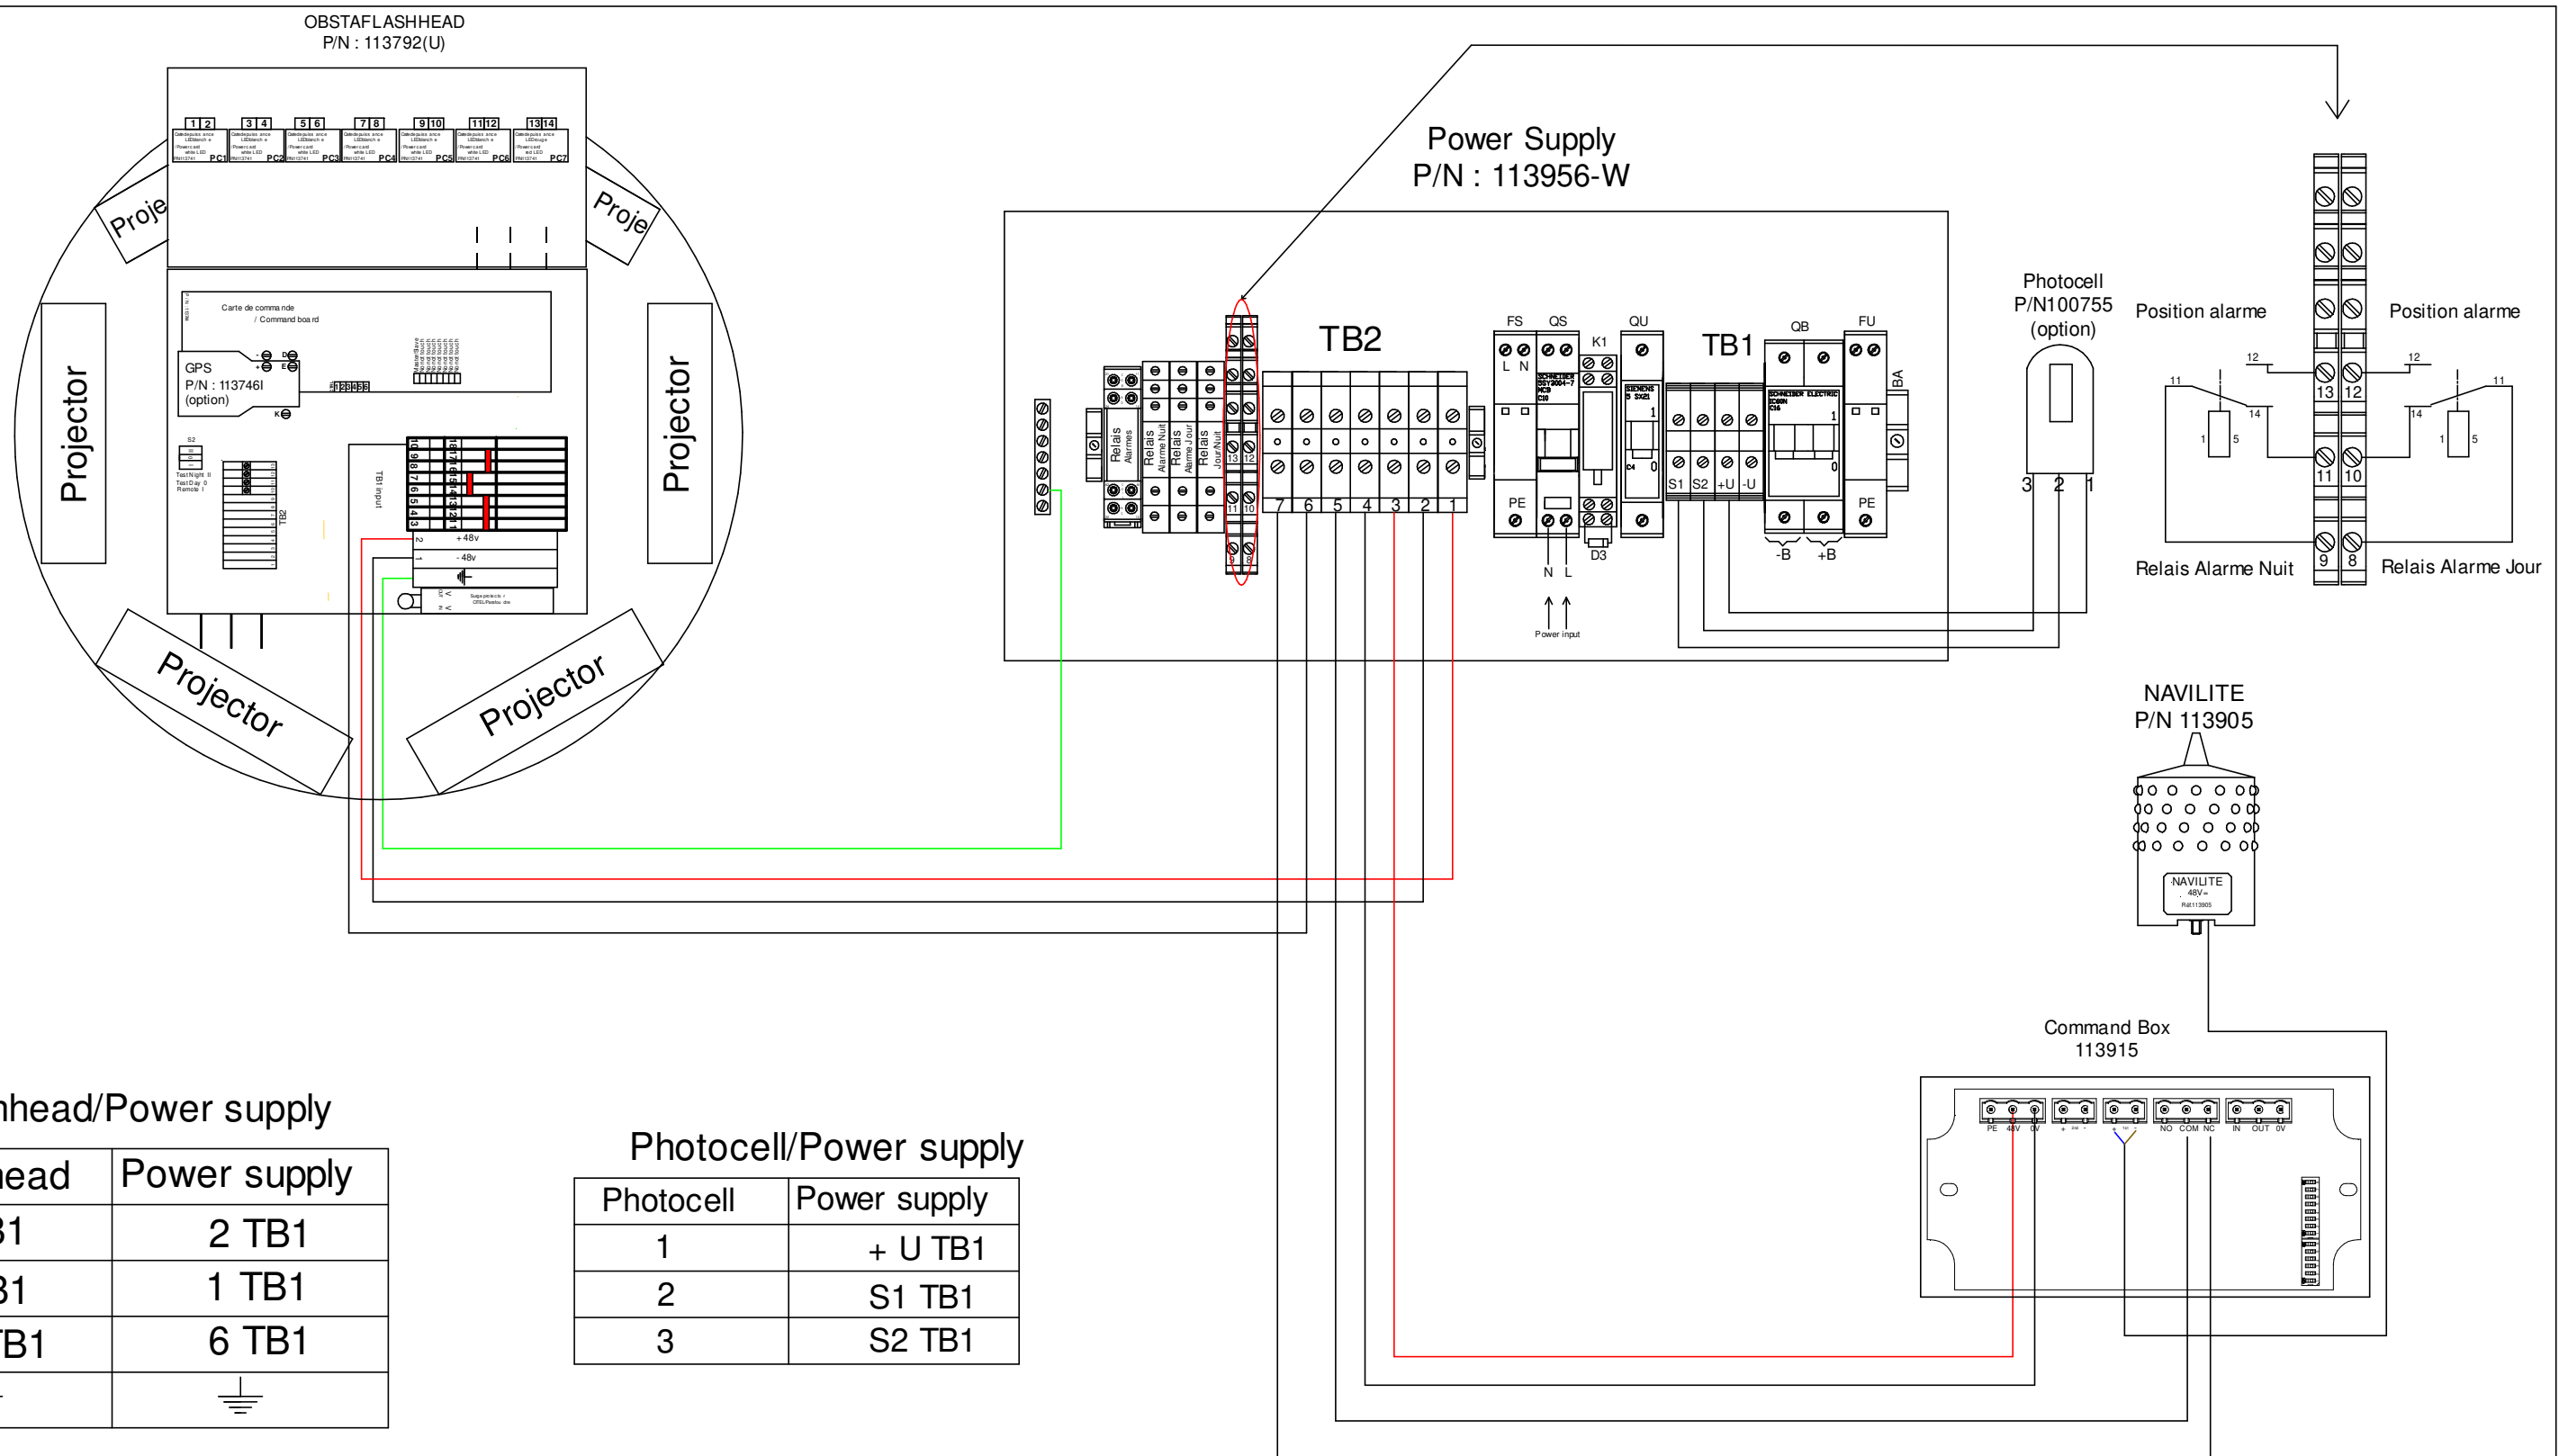

Flashhead/Power supply

Flashhead	Power supply
1 TB1	2 TB1
2 TB1	1 TB1
10 TB1	6 TB1
⏚	⏚

Photocell/Power supply

Photocell	Power supply
1	+ U TB1
2	S1 TB1
3	S2 TB1

Box 113915/Power supply

Box 113915	Power supply
-	4 TB2
+	3 TB2
NC Alarm	5 TB2
COM Alarm	7 TB2

Box 113915/NAVILITE

Box 113915	NAVILITE
- 1 st	-
+ 1 st	+

A	16/03/20	Modif branchement alarme 113915				
IND/REV	DATE	NATURE DE LA MODIFICATION / MODIFICATION				
OBSTA Reims Factory		Typical Lighting System Installation				
3, Impasse de la Blanchisserie BP 56 51052 REIMS CEDEX (France) Tel. 03.26.85.74.00 Fax. 03.26.85.74.30		CODE:		PLAN: O-CUS-00043-0FP		A
REPERE DESSIN / REFERENCE DRAWING		ECHELLE: / SCALE:		MATIERE: / MATERIAL:		ANNULE ET REMPLACE / CANCELED AND REPLACED
DESSINE PAR: / DESIGNED BY: R.PELLEGRINO		DATE: 01/03/19		VERIFIE PAR: / CHECKED BY:		APPROUVE PAR: / APPROVED BY: H.BURGAUD
						DATE: 01/03/19
						VISA: