

Box 113915/Power supply

Box 113915	Power supply
-	- U2
+	Q U2
NC Alarm	5 TB2
COM Alarm	7 TB2

Box 113915/NAVILITE


Box 113915	NAVILITE
- 1 st	-
+ 1 st	+

Box 113915/Box 113943

Box 113915	Box 113943
- 2 nd	1
+ 1 nd	2

Box 113943/NAVILITE

Box 113943	NAVILITE
7	-
8	+

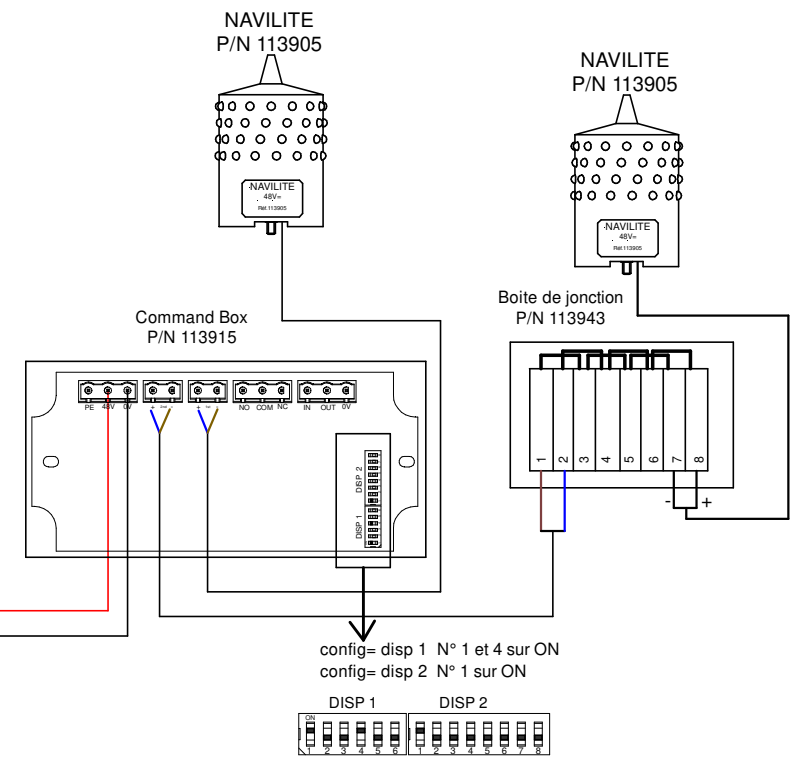

Flashhead/power supply

Flashhead	Power supply
1 TB1	- U1
2 TB1	QU2
7 TB1	QU1
10 TB1	1 TB2
⏏	⏏

Photocell

Photocell	Power supply
1	S2
2	S1
3	- U2

IND/REV	DATE	NATURE DE LA MODIFICATION <i>MODIFICATION</i>				
OBSTA Reims Factory		Typical Lighting System Installation				
3, Impasse de la Blanchisserie BP 56 51052 REIMS CEDEX (France) Tel. 03.26.85.74.00 Fax. 03.26.85.74.30		CODE:	PLAN: DRAWING:	O-CUS-00084-OFI		
REPERE DESSIN REFERENCE DRAWING:		ECHELLE: SCALE:	MATIERE: MATERIAL:	ANNULE ET REMPLACE CANCELED AND REPLACED		
DESSINE PAR: DESIGNED BY:	DATE:	VERIFIE PAR: CHECKED BY:	DATE:	APPROUVE PAR: APPROVED BY:	DATE:	VISA:
R.PELLEGRINO	20/08/20			H.BURGAUD	20/08/20	

This drawing it covers are the property of OBSTA. This document cannot be reproduced, copied or communicated with third parties without the authorization of OBSTA. Ce document est la propriété d'OBSTA. Il ne peut être reproduit ou communiqué à des tiers sans son autorisation.